

1  
2  
3  
4  
5  
6  
7  
8  
9  
10  
11  
12  
13  
14  
15  
16  
17  
18  
19  
20  
21  
22  
23  
24  
25  
26  
27  
28  
29  
30  
31  
32  
33  
34  
35  
36  
37  
38  
39  
40  
41  
42  
43  
44  
45  
46  
47  
48  
49  
50  
51  
52  
53  
54

**ADDENDUM NO. 1**

ISSUE DATE: **August 21, 2023**

RE: **Camp Randall Stadium East Bowl Recoating  
University of Wisconsin - Madison  
Madison, Wisconsin**

**UW-Madison Project No. 0022-2304  
UWSA Project No. A-22-020**

**BID SUBMISSION FOR GPC BIDDERS: 2:00 P.M., August 30, 2023.**

From: **Berners-Schober Associates, Inc.  
310 Pine Street  
Green Bay, Wisconsin 54301**

TO: Prospective Bidders

This addendum forms a part of the Contract Documents and modifies the original Contract Documents dated **August 2, 2023** as noted below. Acknowledge receipt of this Addendum by inserting the number and issue date of this addendum in the blank space provided on the Bid Form. Failure to do so may subject the Bidder to disqualification.

This addendum consists of **2 pages** and the attached document:

- **Drawing S200 DETAILS dated 8/21/2023**

**GENERAL:**

1. Pre-Bid Question: Can we work past City of Madison sound ordinance and use Camp Randall Lights?

Response: West side field lights can remain on until 10:00 P.M. Sound ordinance must be adhered to.

2. Pre-Bid Question: Can we start earlier than May 15<sup>th</sup>?

RESPONSE: Hold schedule as outlined in bid documents.

3. Pre-Bid Question: Vomitory walls should be coated with breathable paint, not with traffic coating. Traffic coating will not allow the concrete to breathe. Existing paint on inside walls of the vomitory are not breathable and coating outside and top would lock in moisture. Please specify an acceptable product.

Response: Details have been updated to terminate coating at base of wall. See detail 7/S200 on Sheet 200 re-issued with this addendum.

4. Pre-Bid Question: Please confirm that all concrete repair called out in issued construction drawings is to be included in the base bid and that all concrete repair not called out in issued construction drawings (revealed after removal of bleachers, etc.) is to be quantified and added after award of the base bid, based on unit prices included in the base bid.

Response: The repairs shown and quantified on the drawings are part of the base bid and anything not shown at this time would be an additional cost based on the unit prices given on the bid form.


**DRAWINGS:**

1. Sheet S200 DETAILS: This sheet is re-issued with this addendum.


1  
2  
3  
4  
5  
6  
7

END OF ADDENDUM


**Berners-Schober Associates, Inc.**  
**310 Pine Street**  
**Green Bay, Wisconsin 54301**

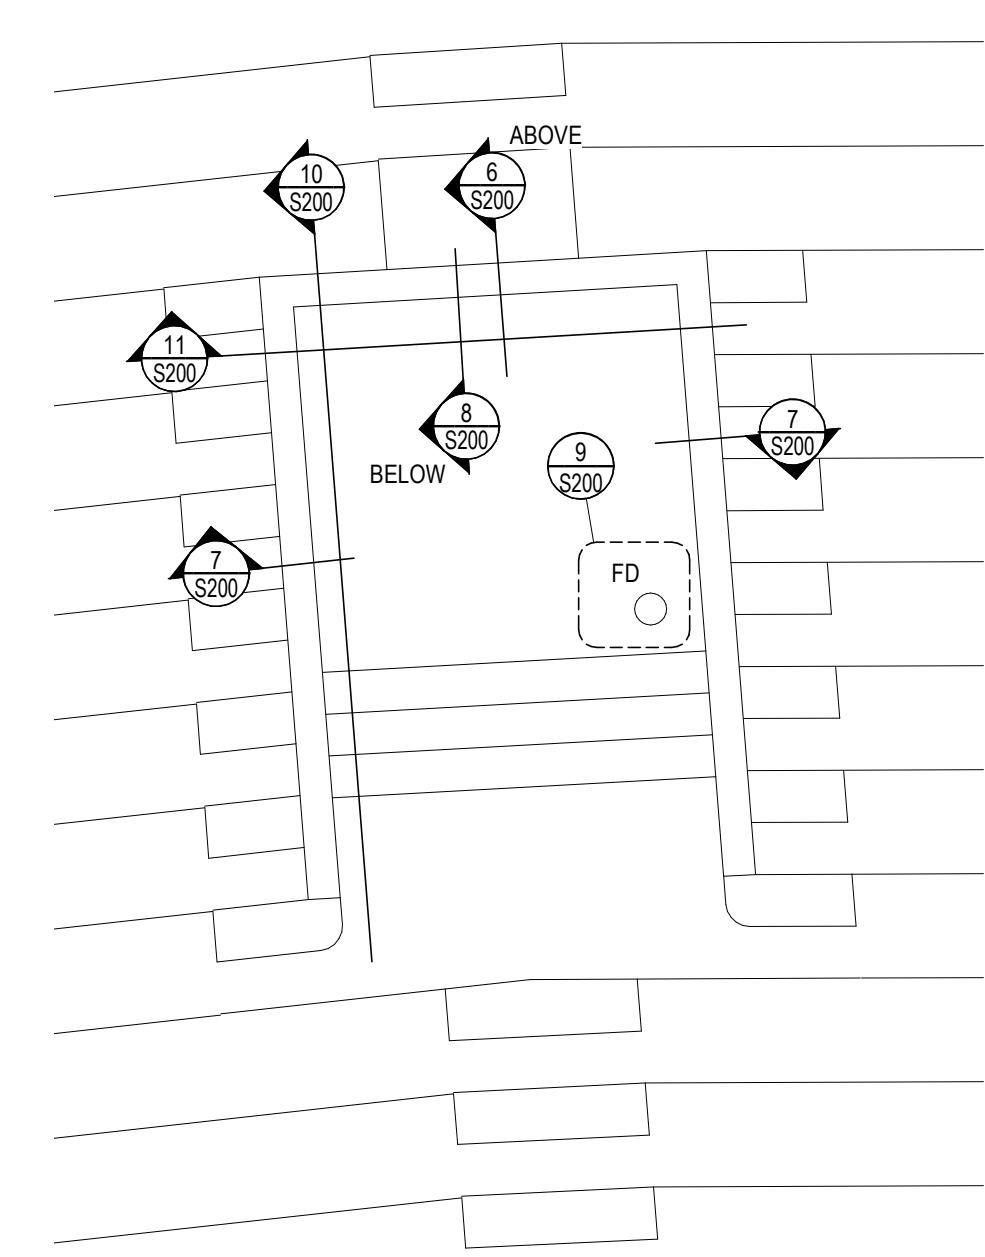


1 VOMITORY ENLARGED PLAN  
SCALE: 1/4" = 1'-0"

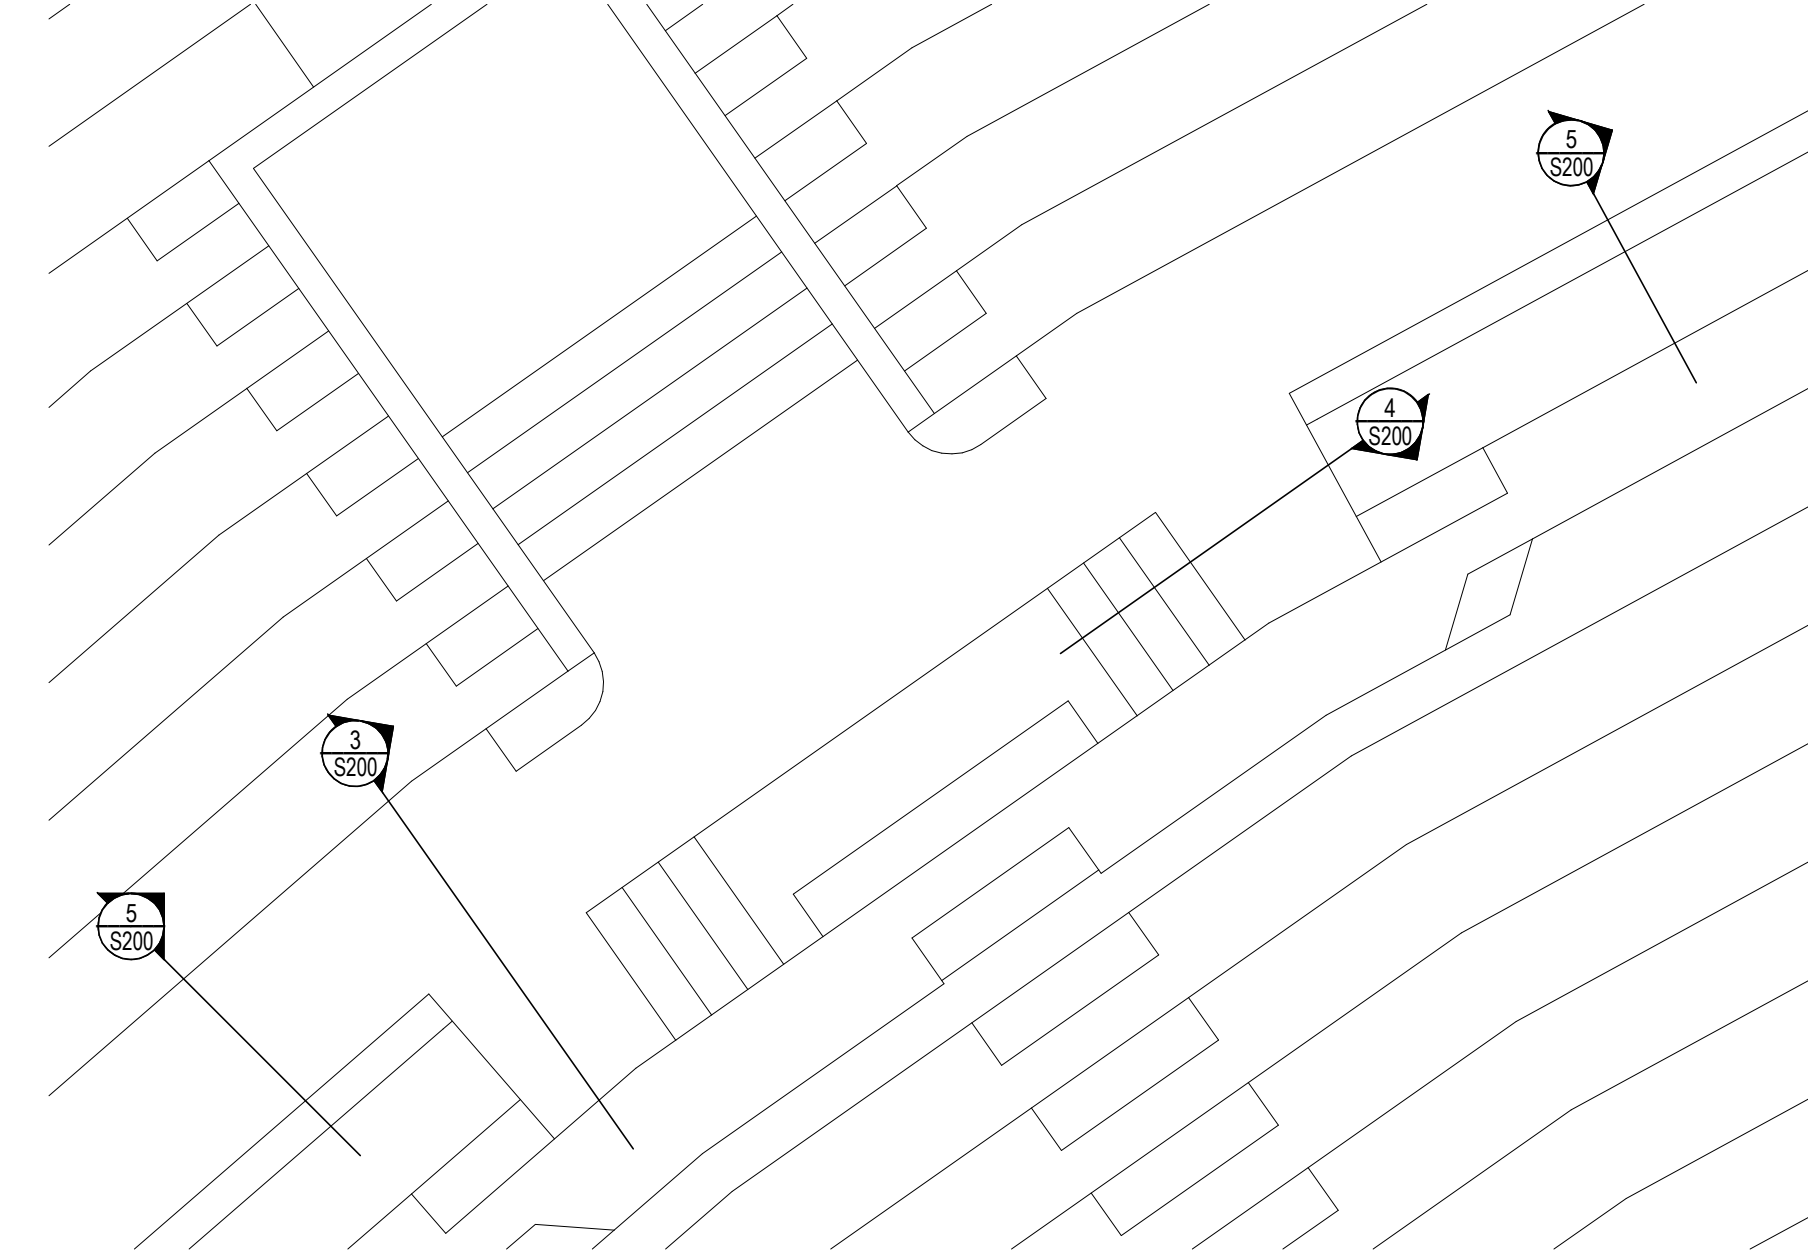

2 CROSS AISLE STAIR PLAN  
SCALE: 1/4" = 1'-0"

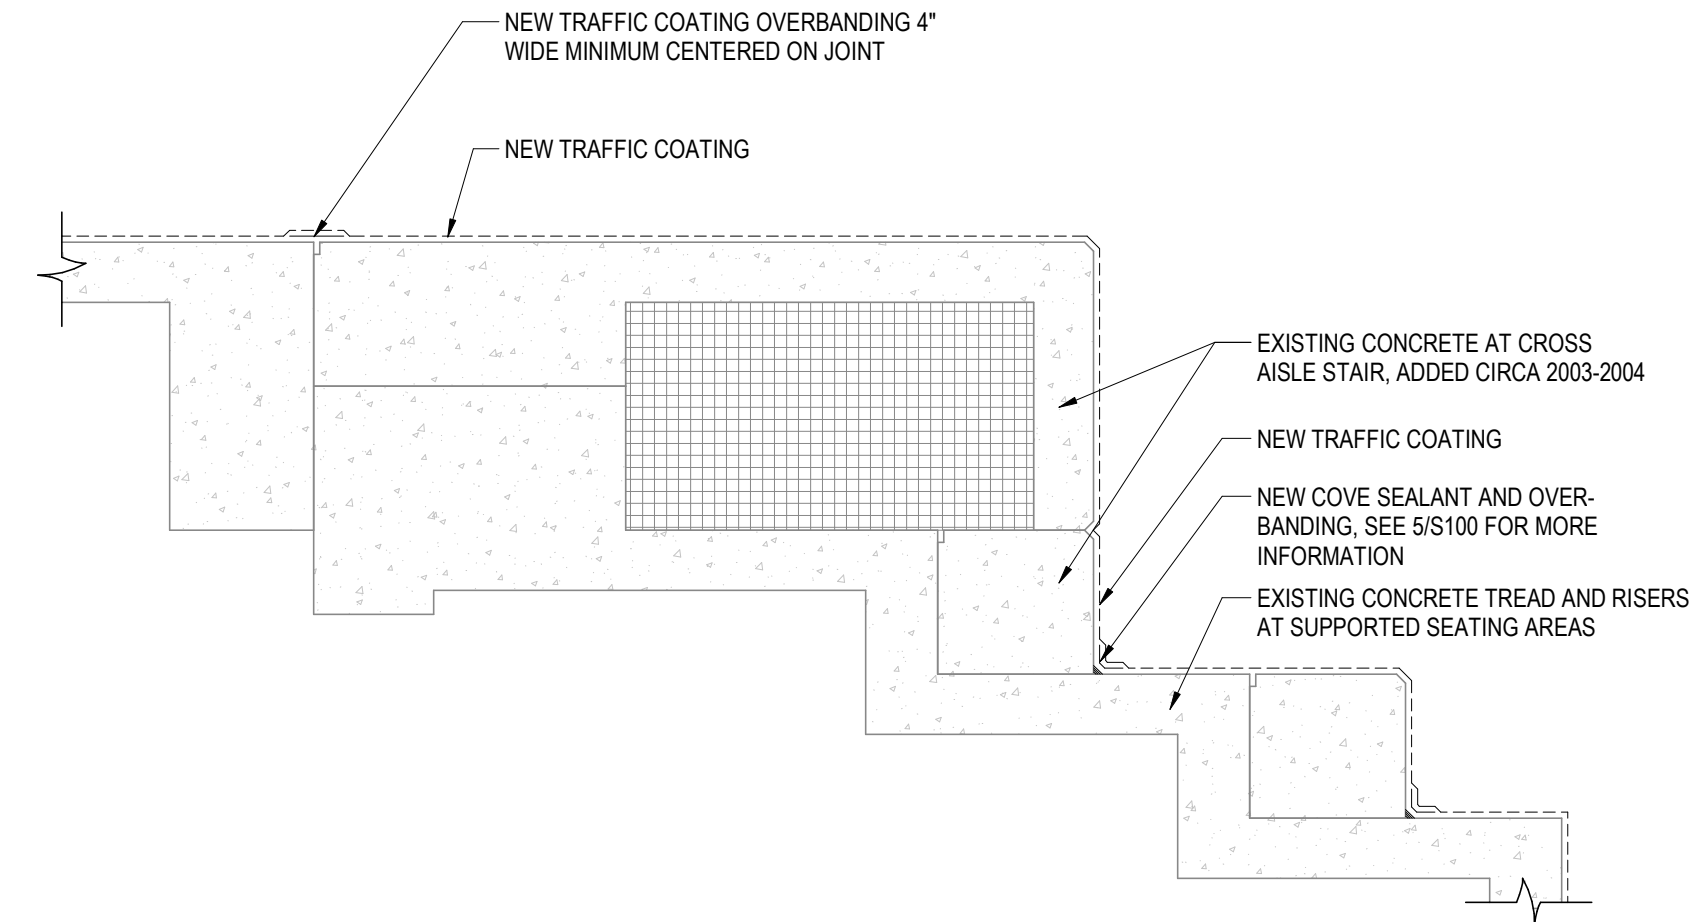


3 SECTION AT CROSS AISLE STAIR  
SCALE: 3/4" = 1'-0"

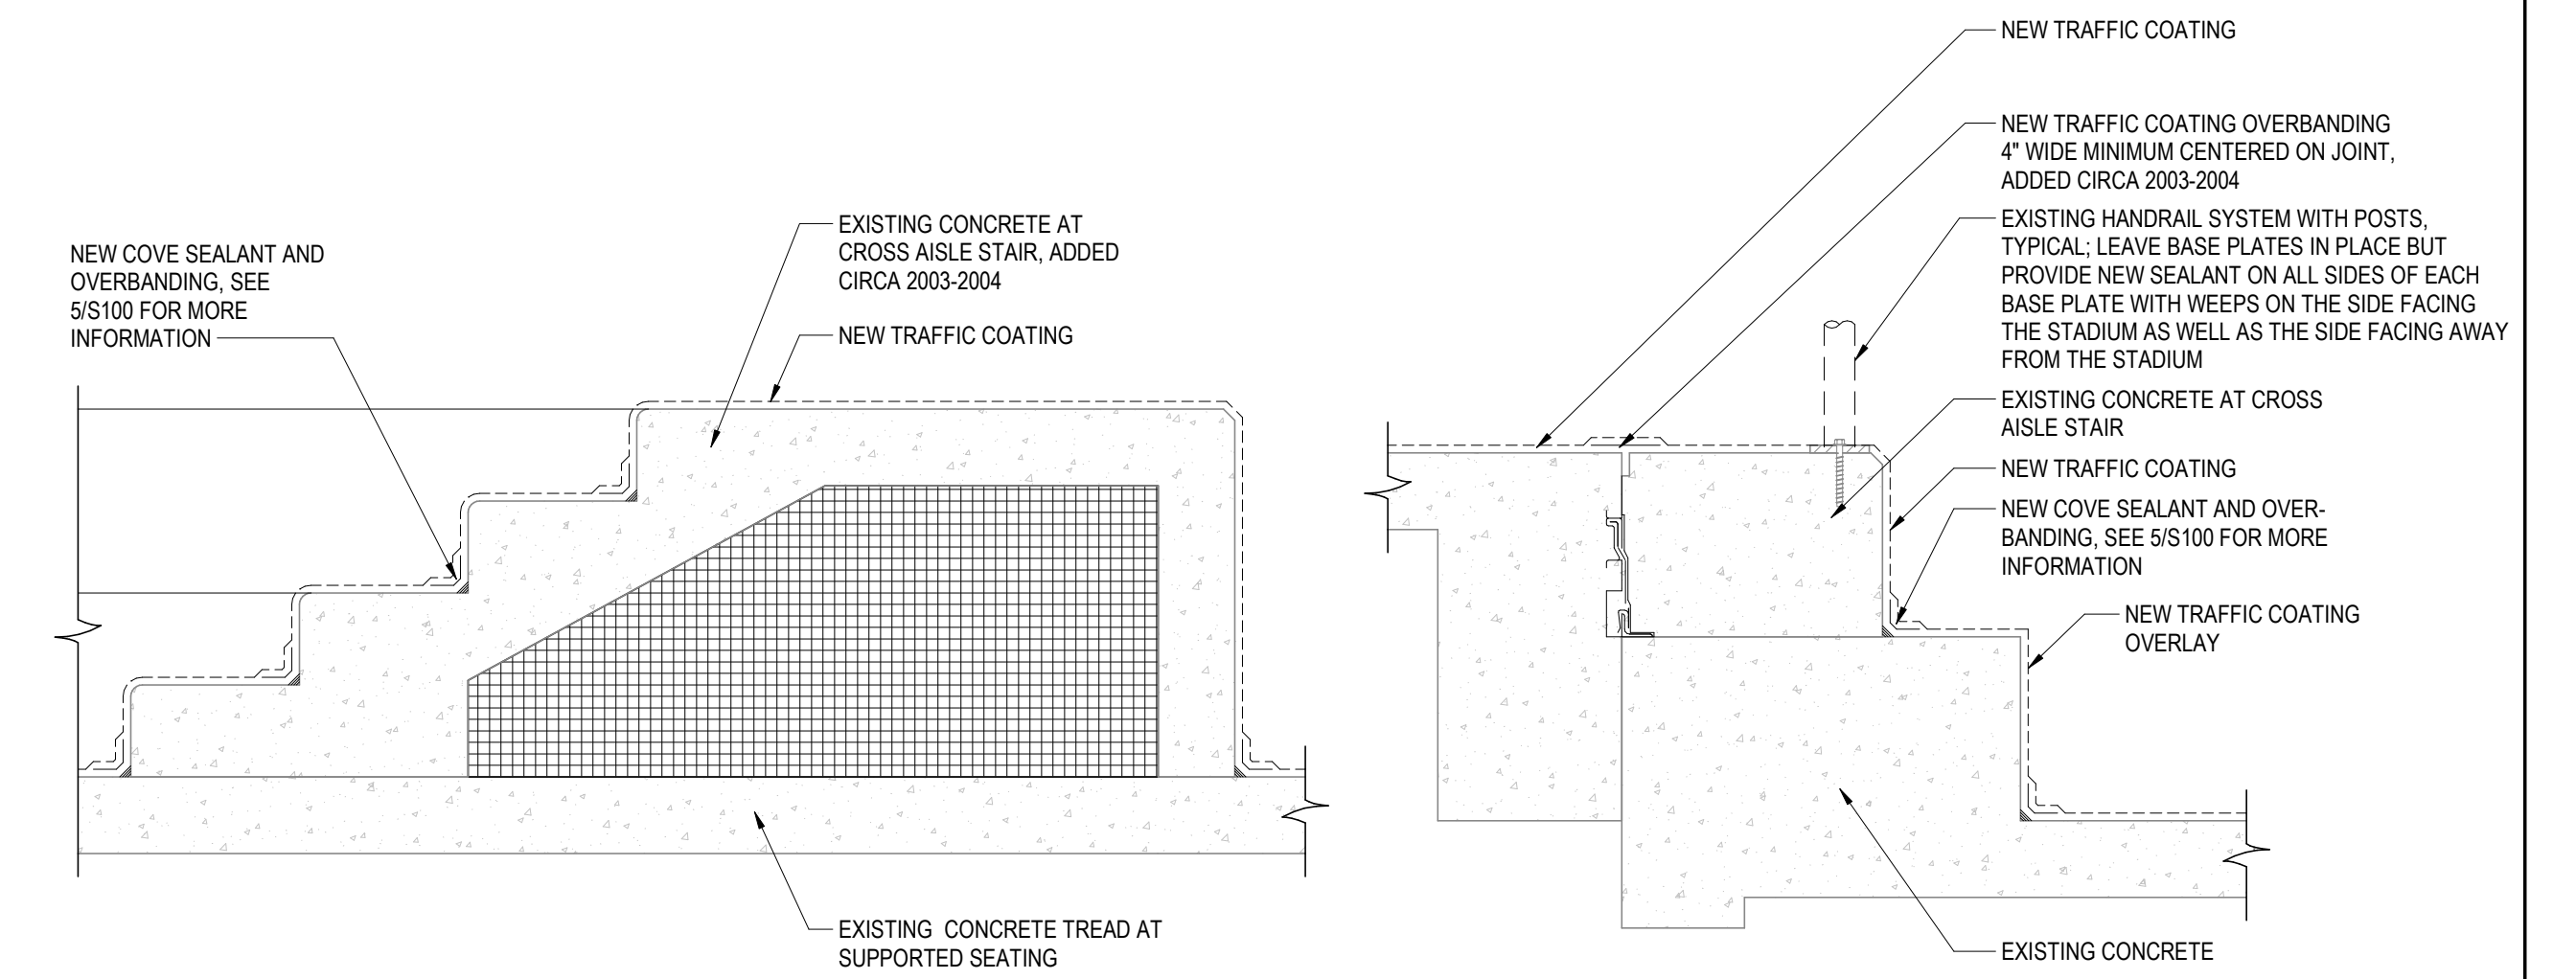


4 SECTION AT CROSS AISLE STAIR  
SCALE: 1" = 1'-0"


5 SECTION AT CROSS AISLE STAIR  
SCALE: 1" = 1'-0"

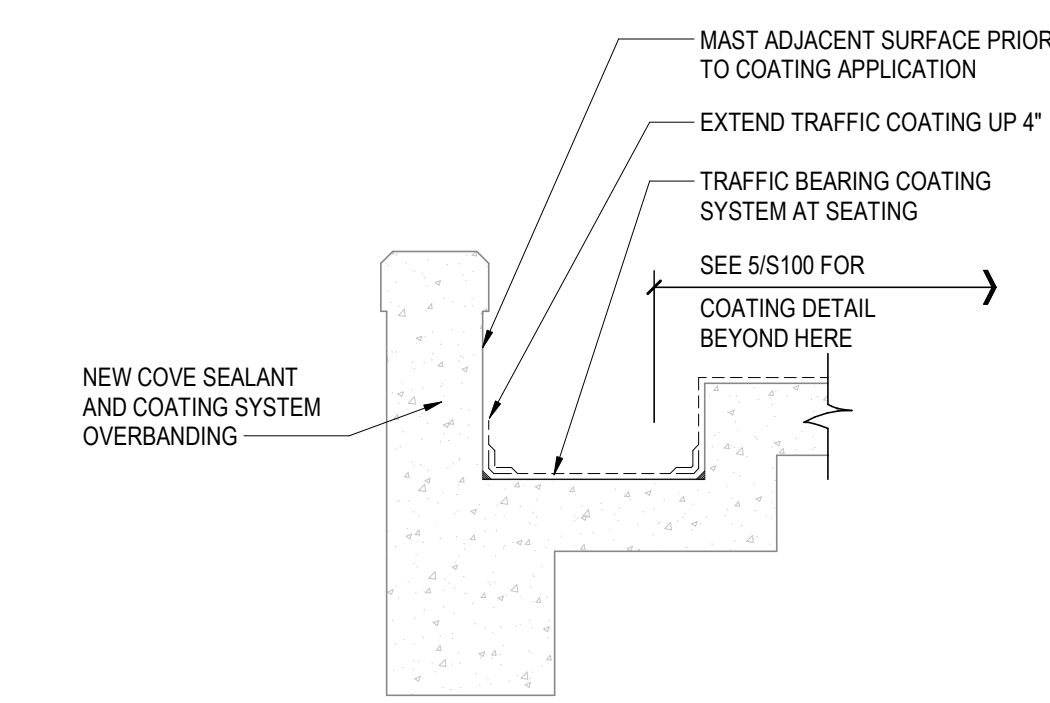


6 SECTION AT BACK WALL OF TYPE 2 VOMITORY  
SCALE: 3/4" = 1'-0"

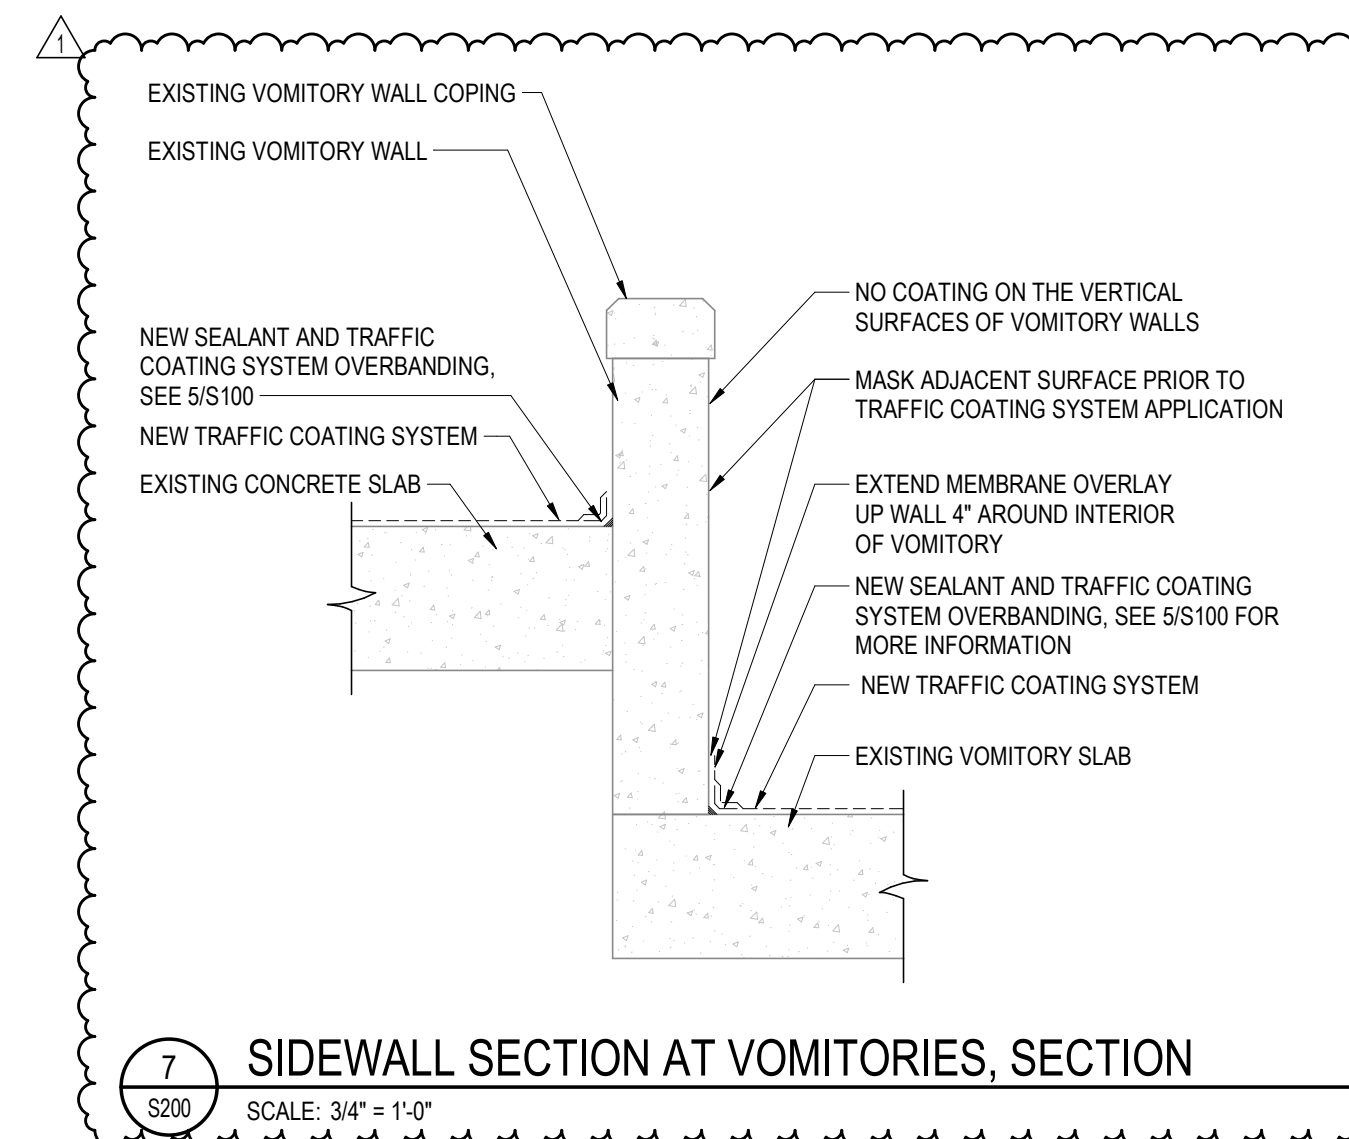


7 SIDEWALL SECTION AT VOMITORIES, SECTION  
SCALE: 3/4" = 1'-0"

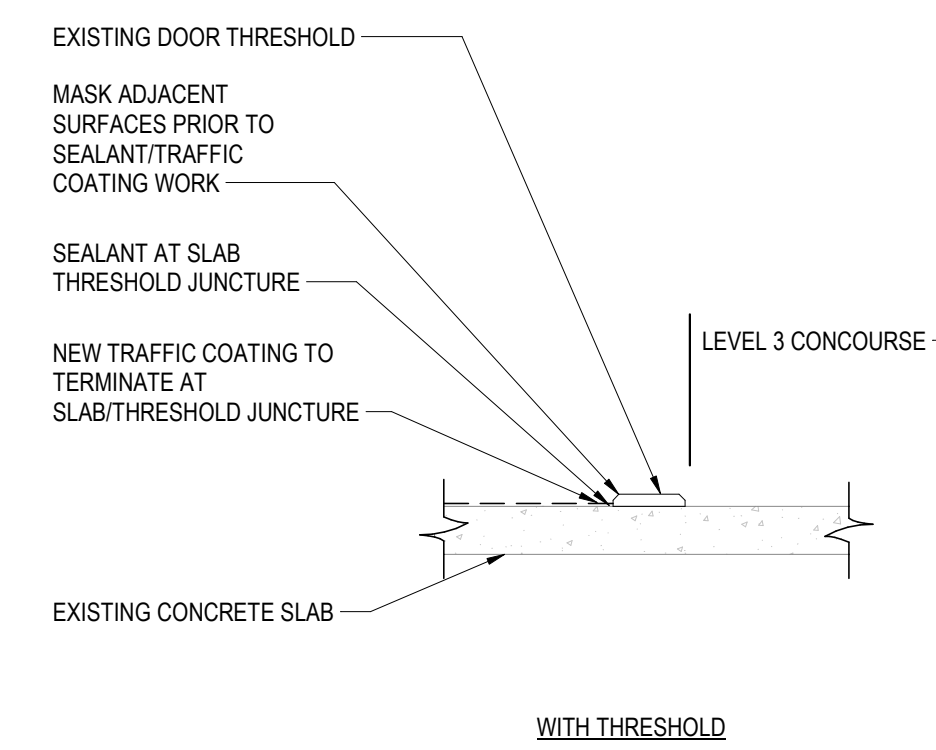


8 RAMP SLAB THRESHOLD JUNCTIONS AT TYPE 2 VOMITORIES  
SCALE: 3/4" = 1'-0"

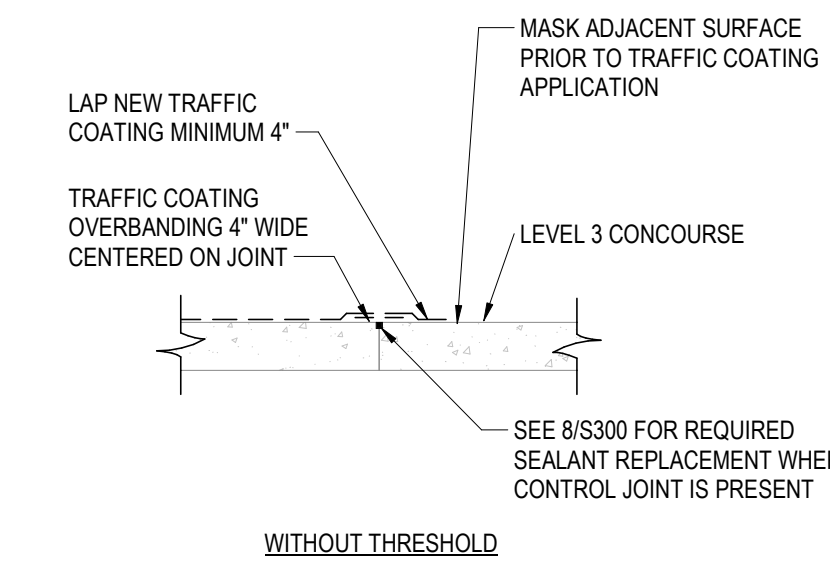


WITHOUT THRESHOLD

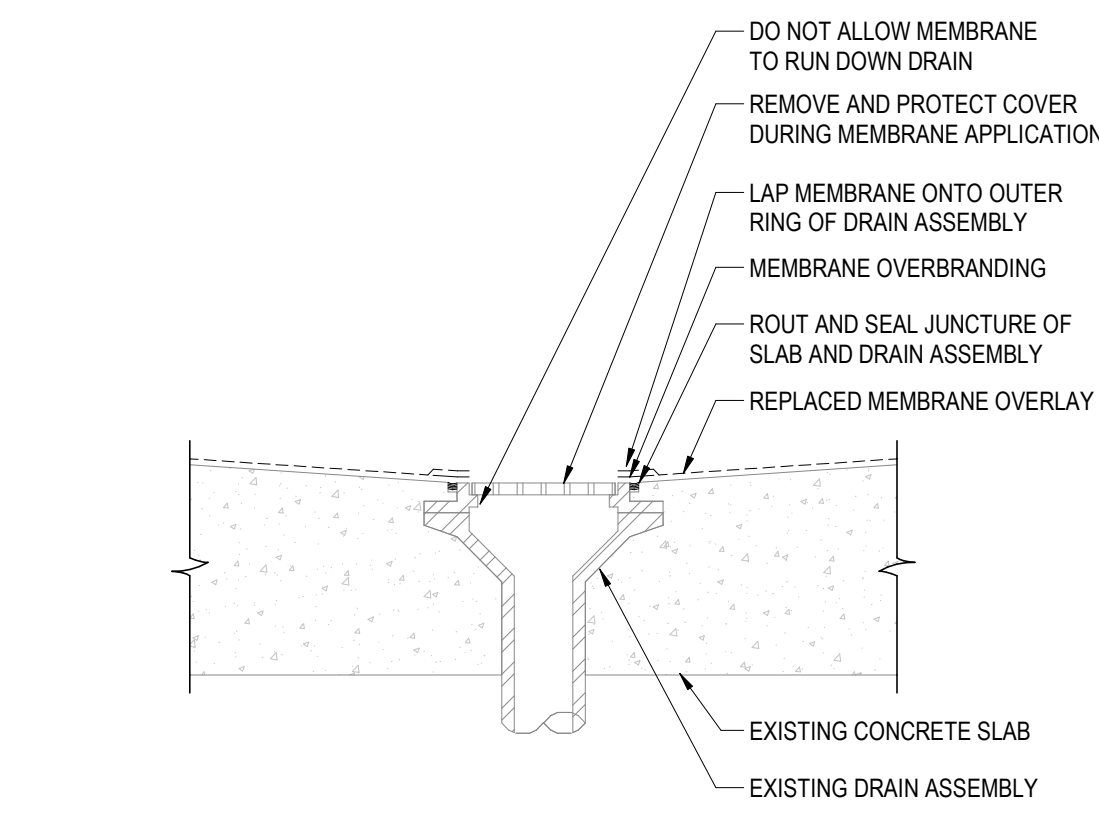


9 TYPICAL SECTION AT DRAIN  
SCALE: 3/4" = 1'-0"

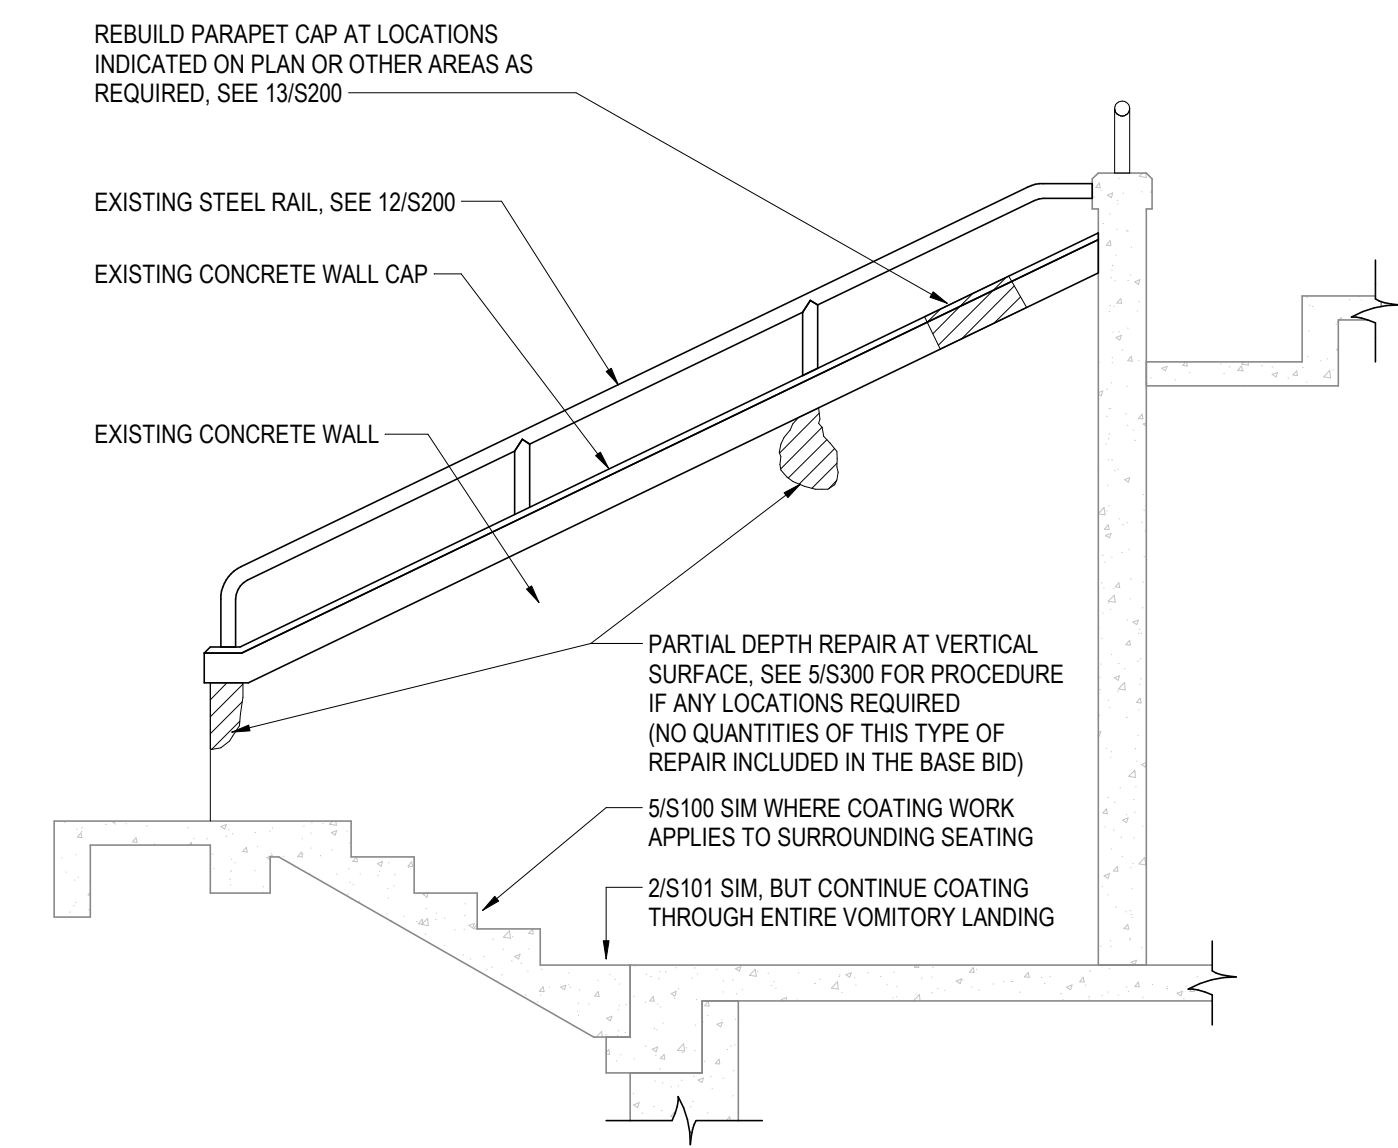


10 TYPE 2 VOMITORY SIDE WALL ELEVATIONS  
SCALE: 3/8" = 1'-0"

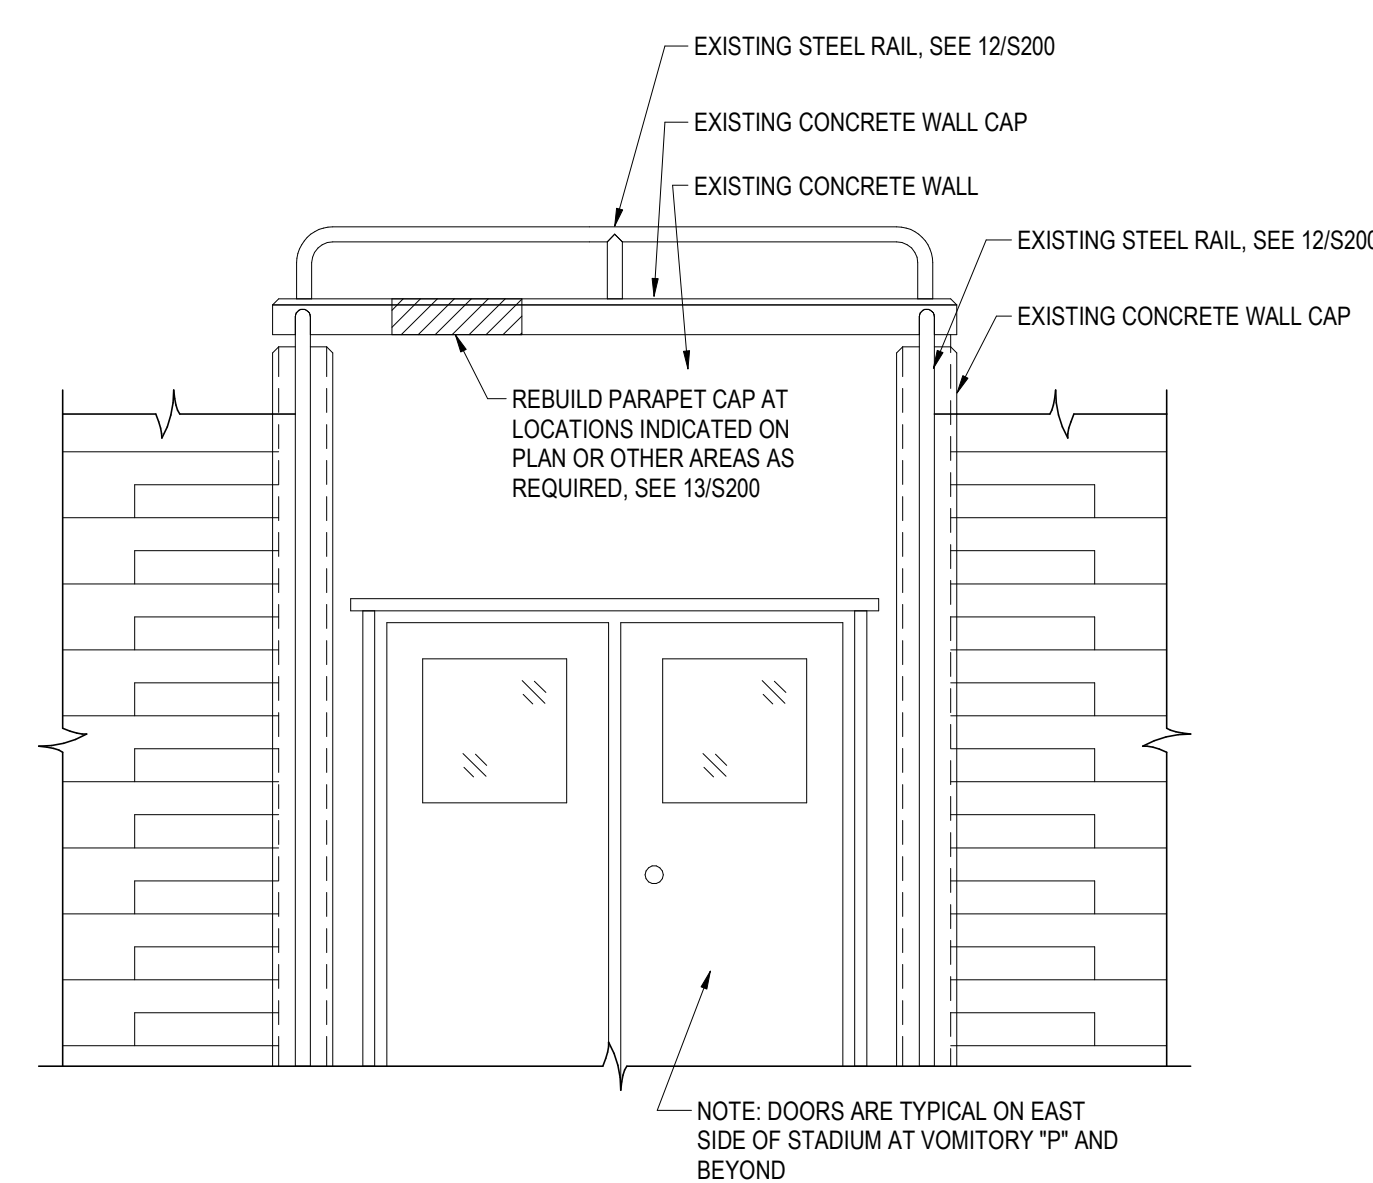

11 TYPE 2 VOMITORY BACK WALL ELEV  
SCALE: 3/8" = 1'-0"

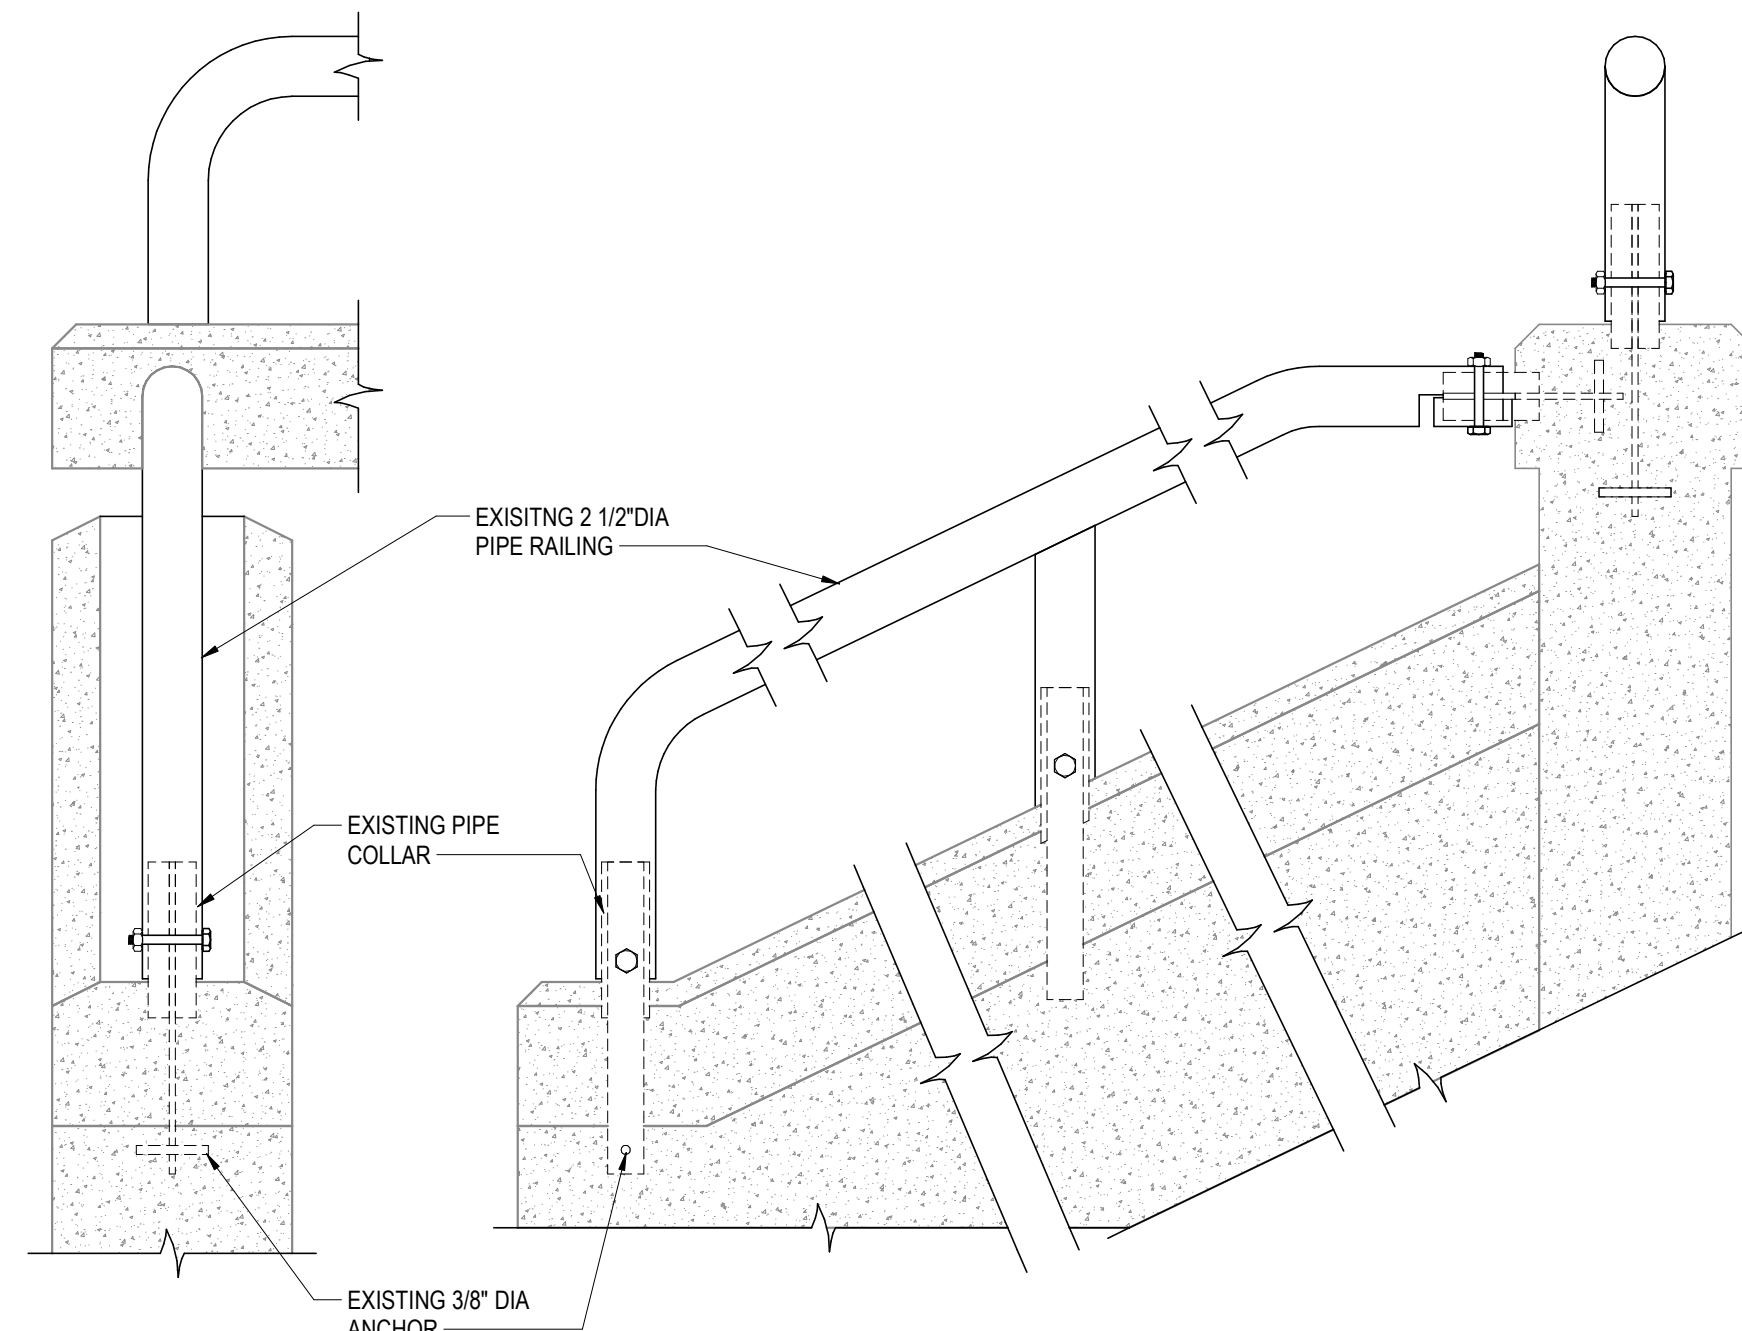

12 PIPE RAILING CONCRETE CAP DETAILS  
SCALE: 1 1/2" = 1'-0"

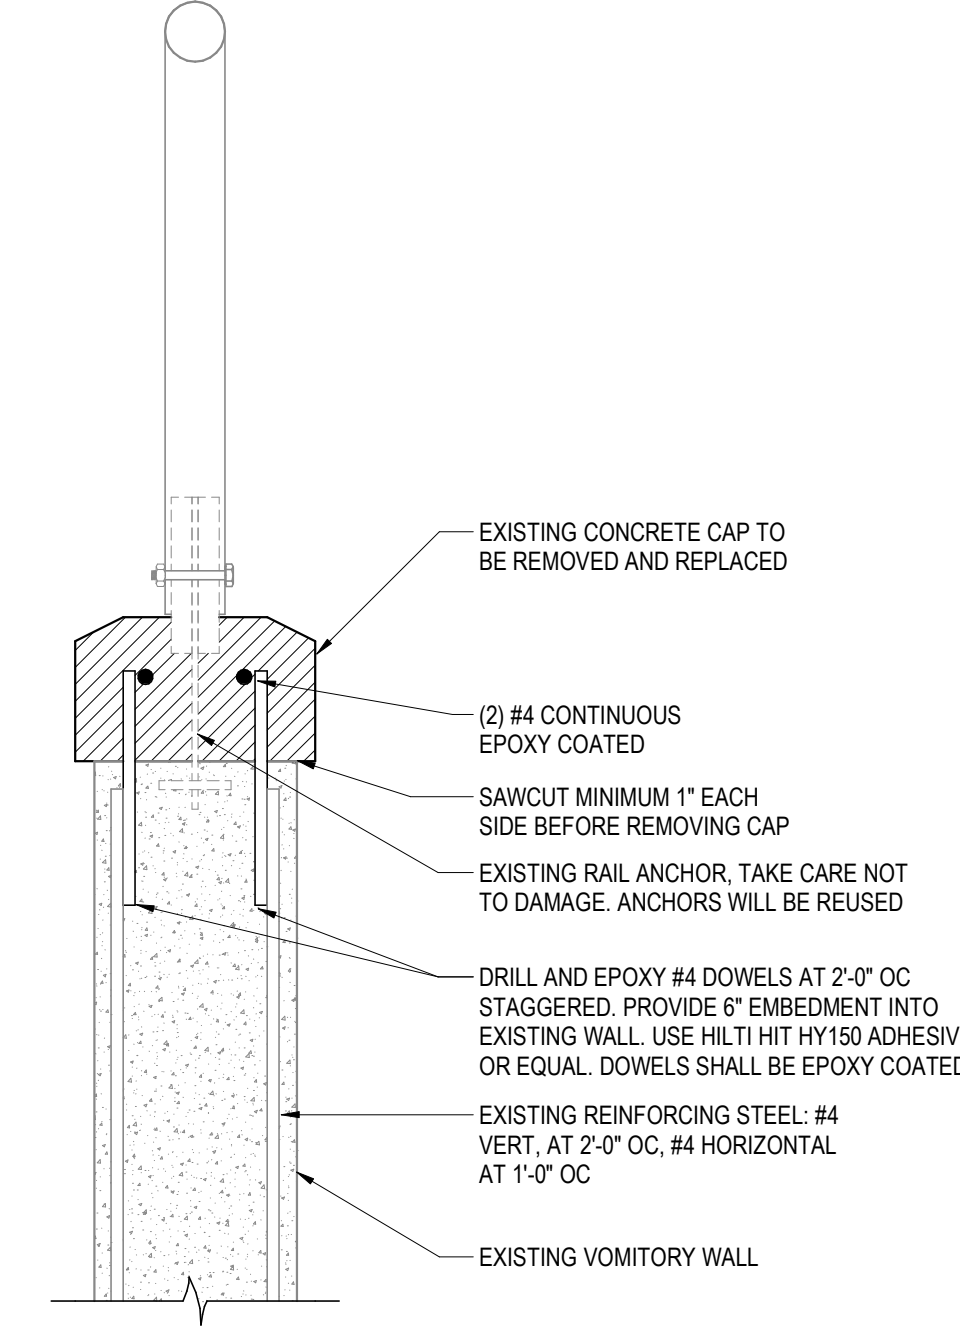

13 CAP REPLACEMENT AT VOMITORY  
SCALE: 1 1/2" = 1'-0"

Revisions:			
No.	Date	By	Description
1	08/21/23		ADDENDUM #1

Graphic Scale	
UWSA #	A-22-020
UWMAD #	022-2304
Set Type	BD
Date Issued	08/02/2023
Sheet Number	<b>S200</b>